

bsens-PRO

Dashboard

Machines Point ▾


- > Gas Drying Unit
- > Water&WestWater
- Refinery

Utility ▾

- ▾ Pump1
 - ☒ Vibration-NDE1-Y
 - ☐ point 10
 - ☐ Keyphasor-1
 - ☒ Vibration-NDE1-X
 - ☐ Vibration-NDE2


SETTINGS

- Point settings >
- Device settings >

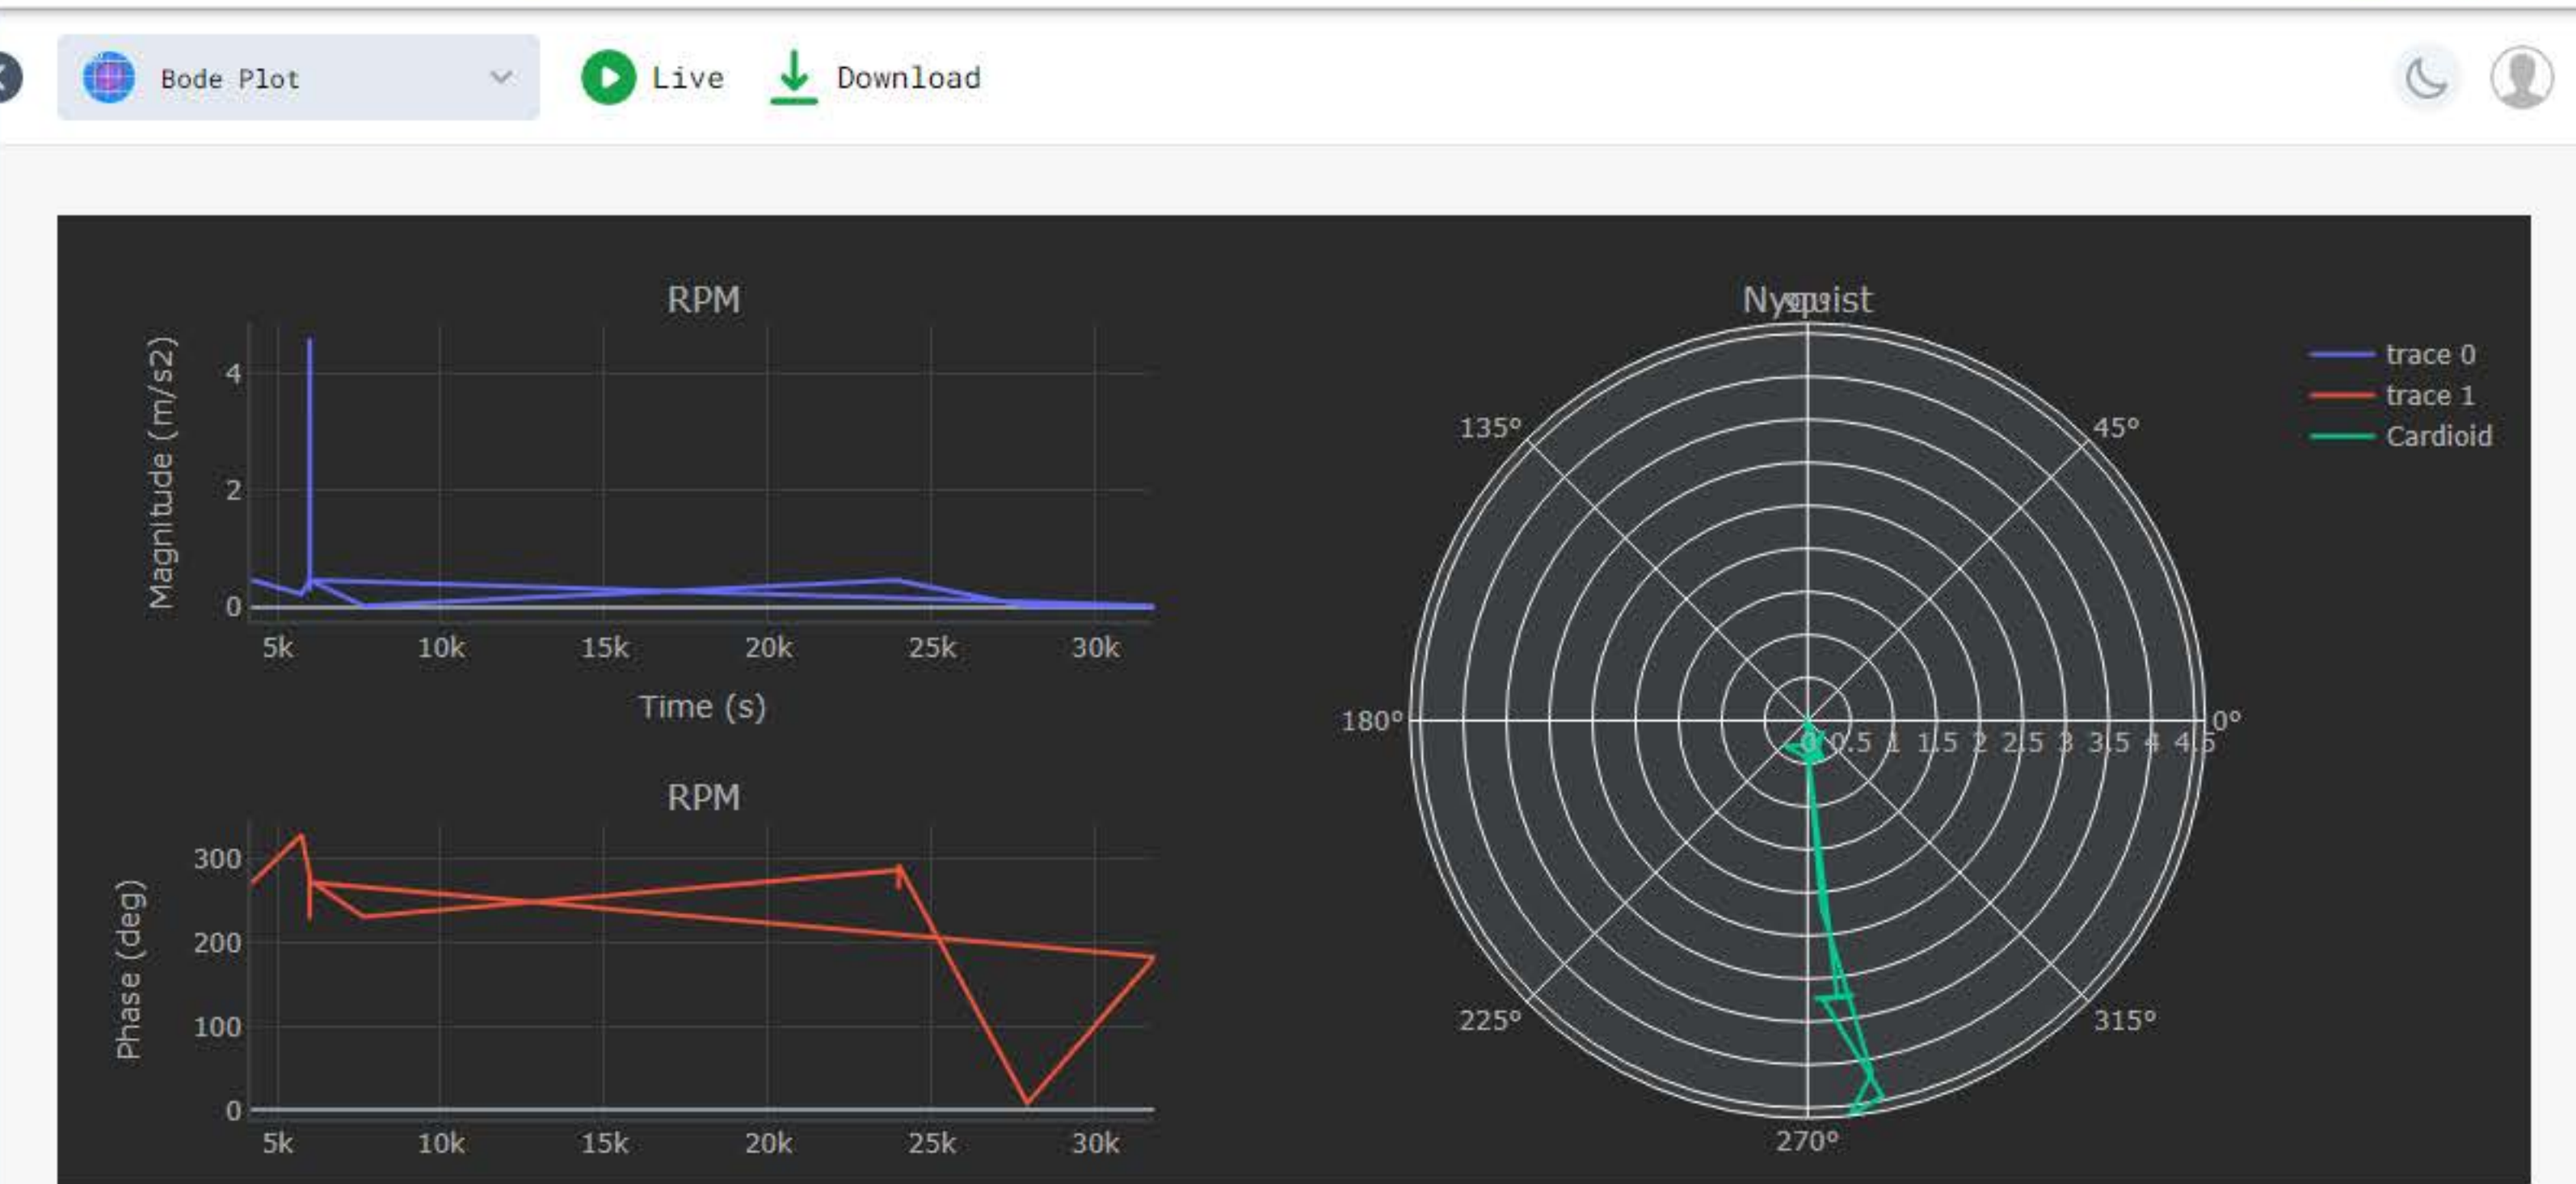



Polar:

04/19/2023 05:07 PM

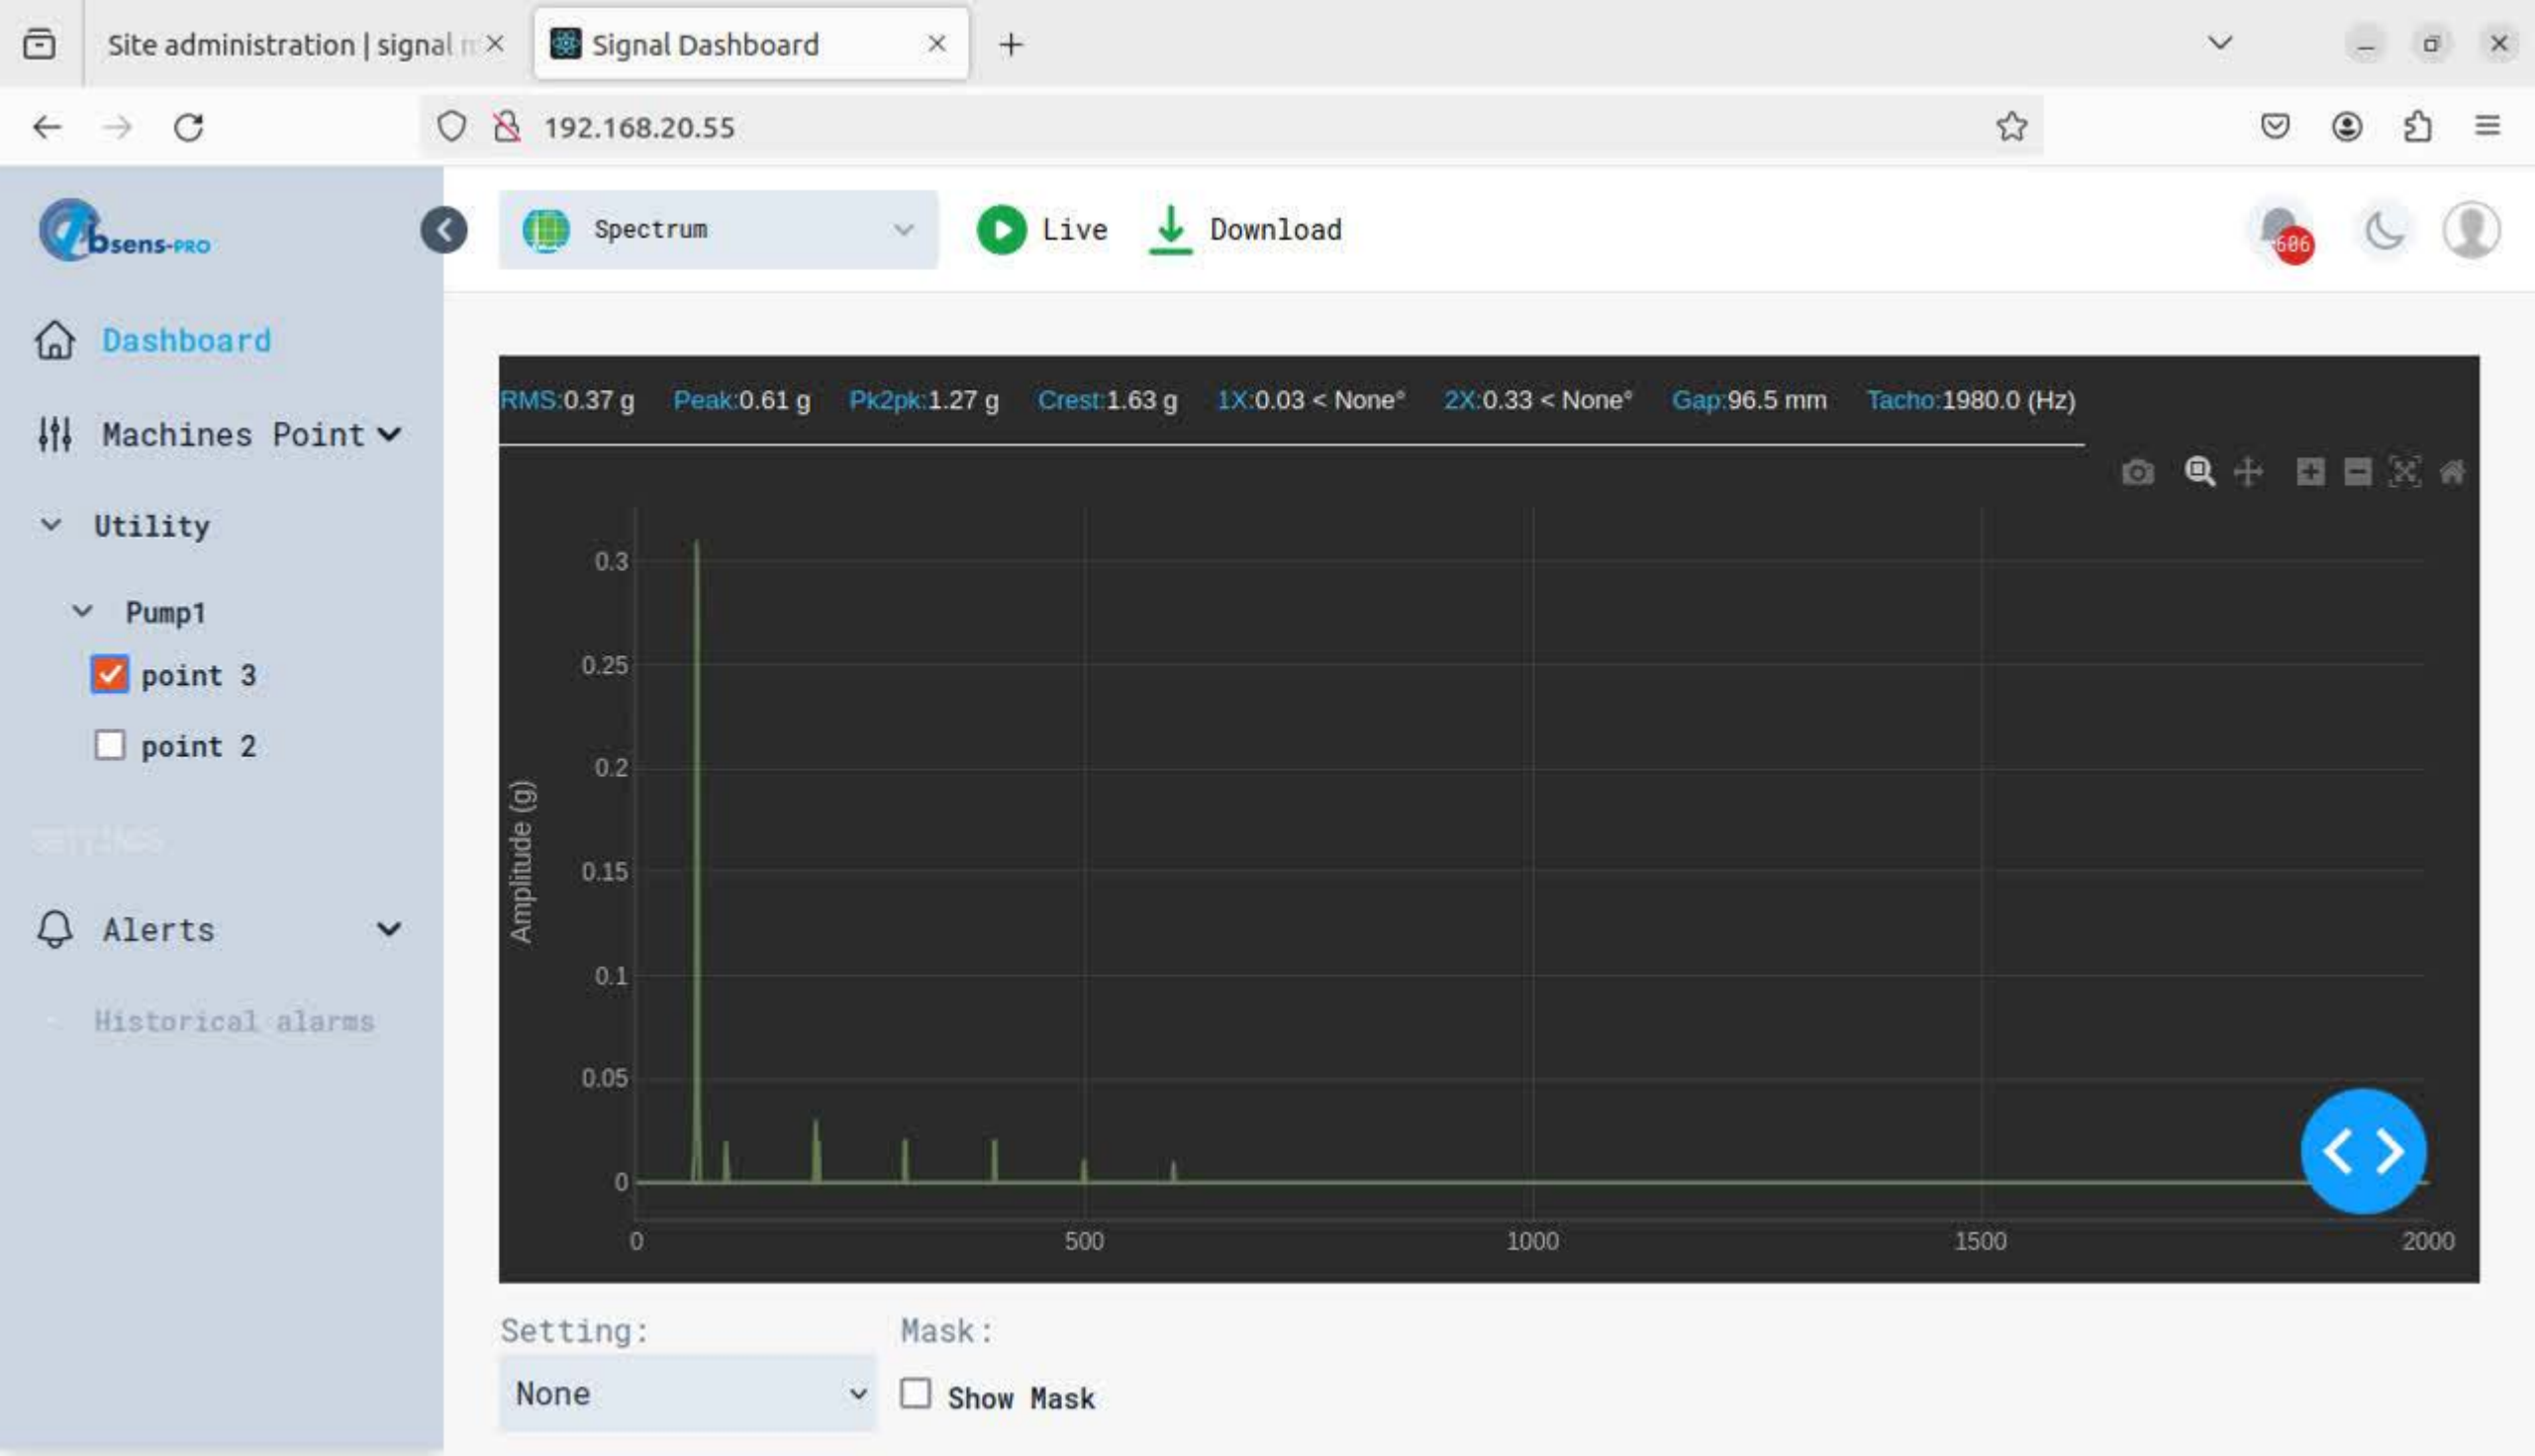

All maps / TURBINE

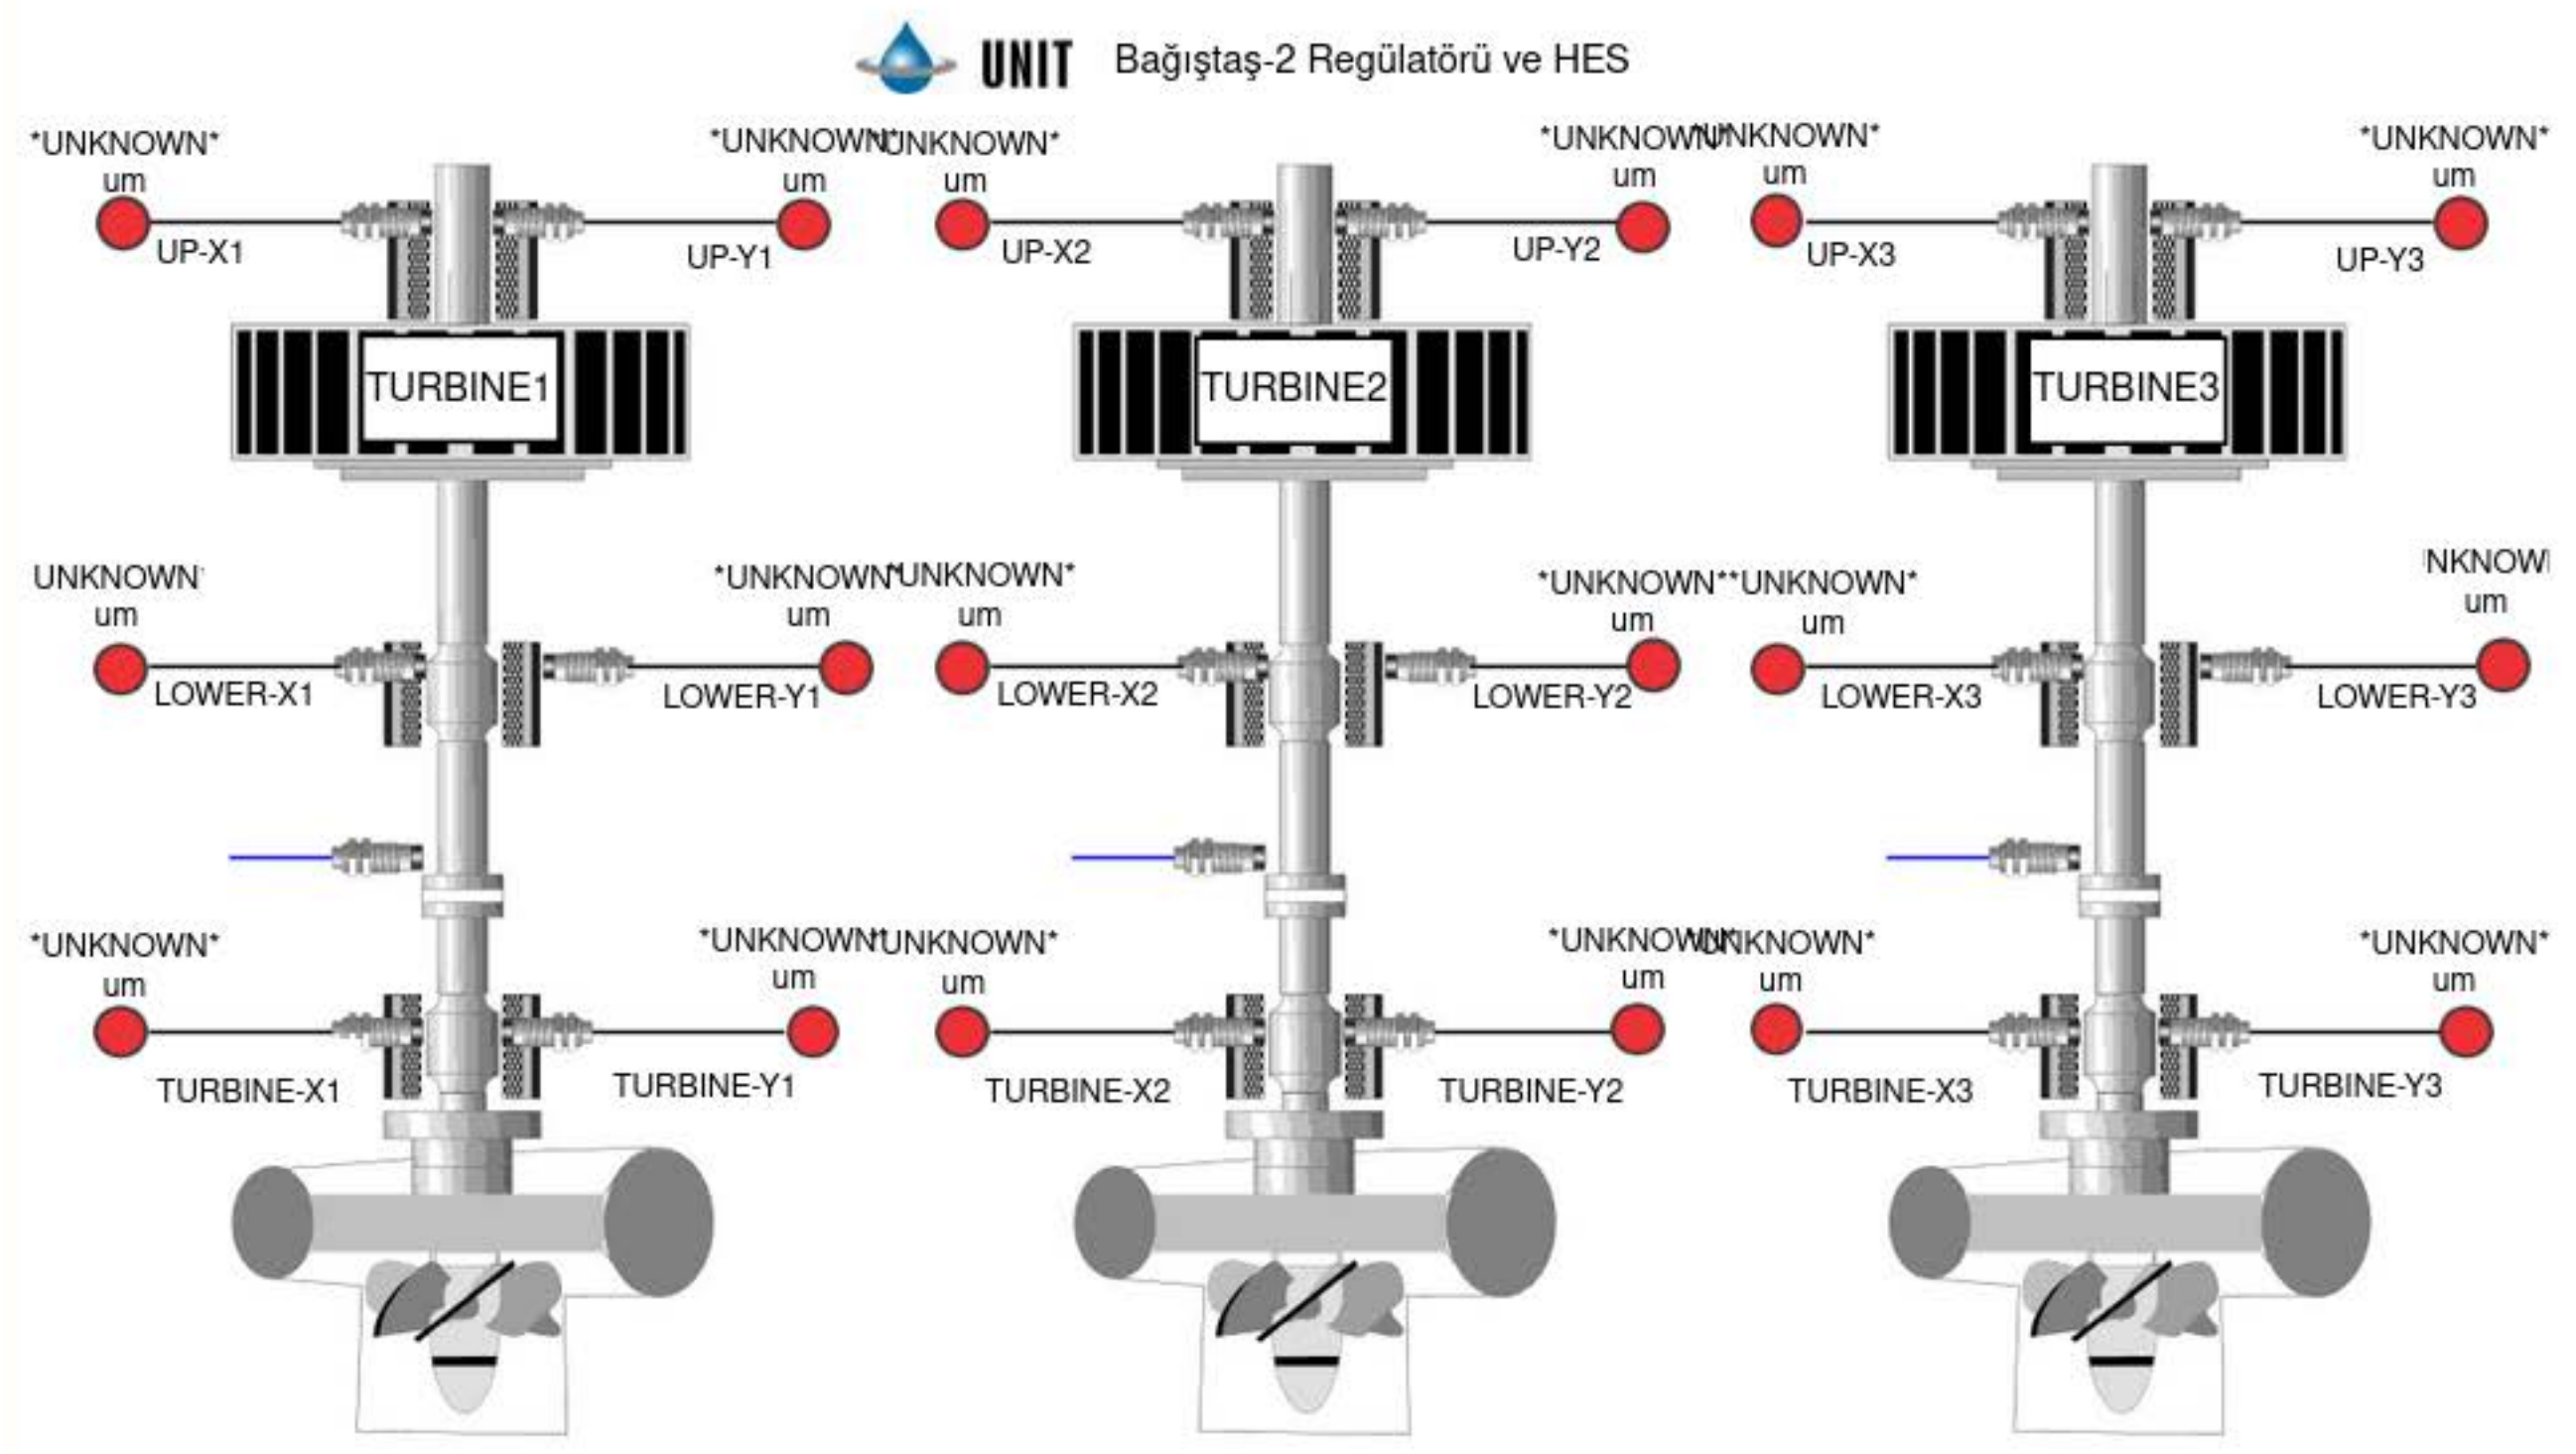

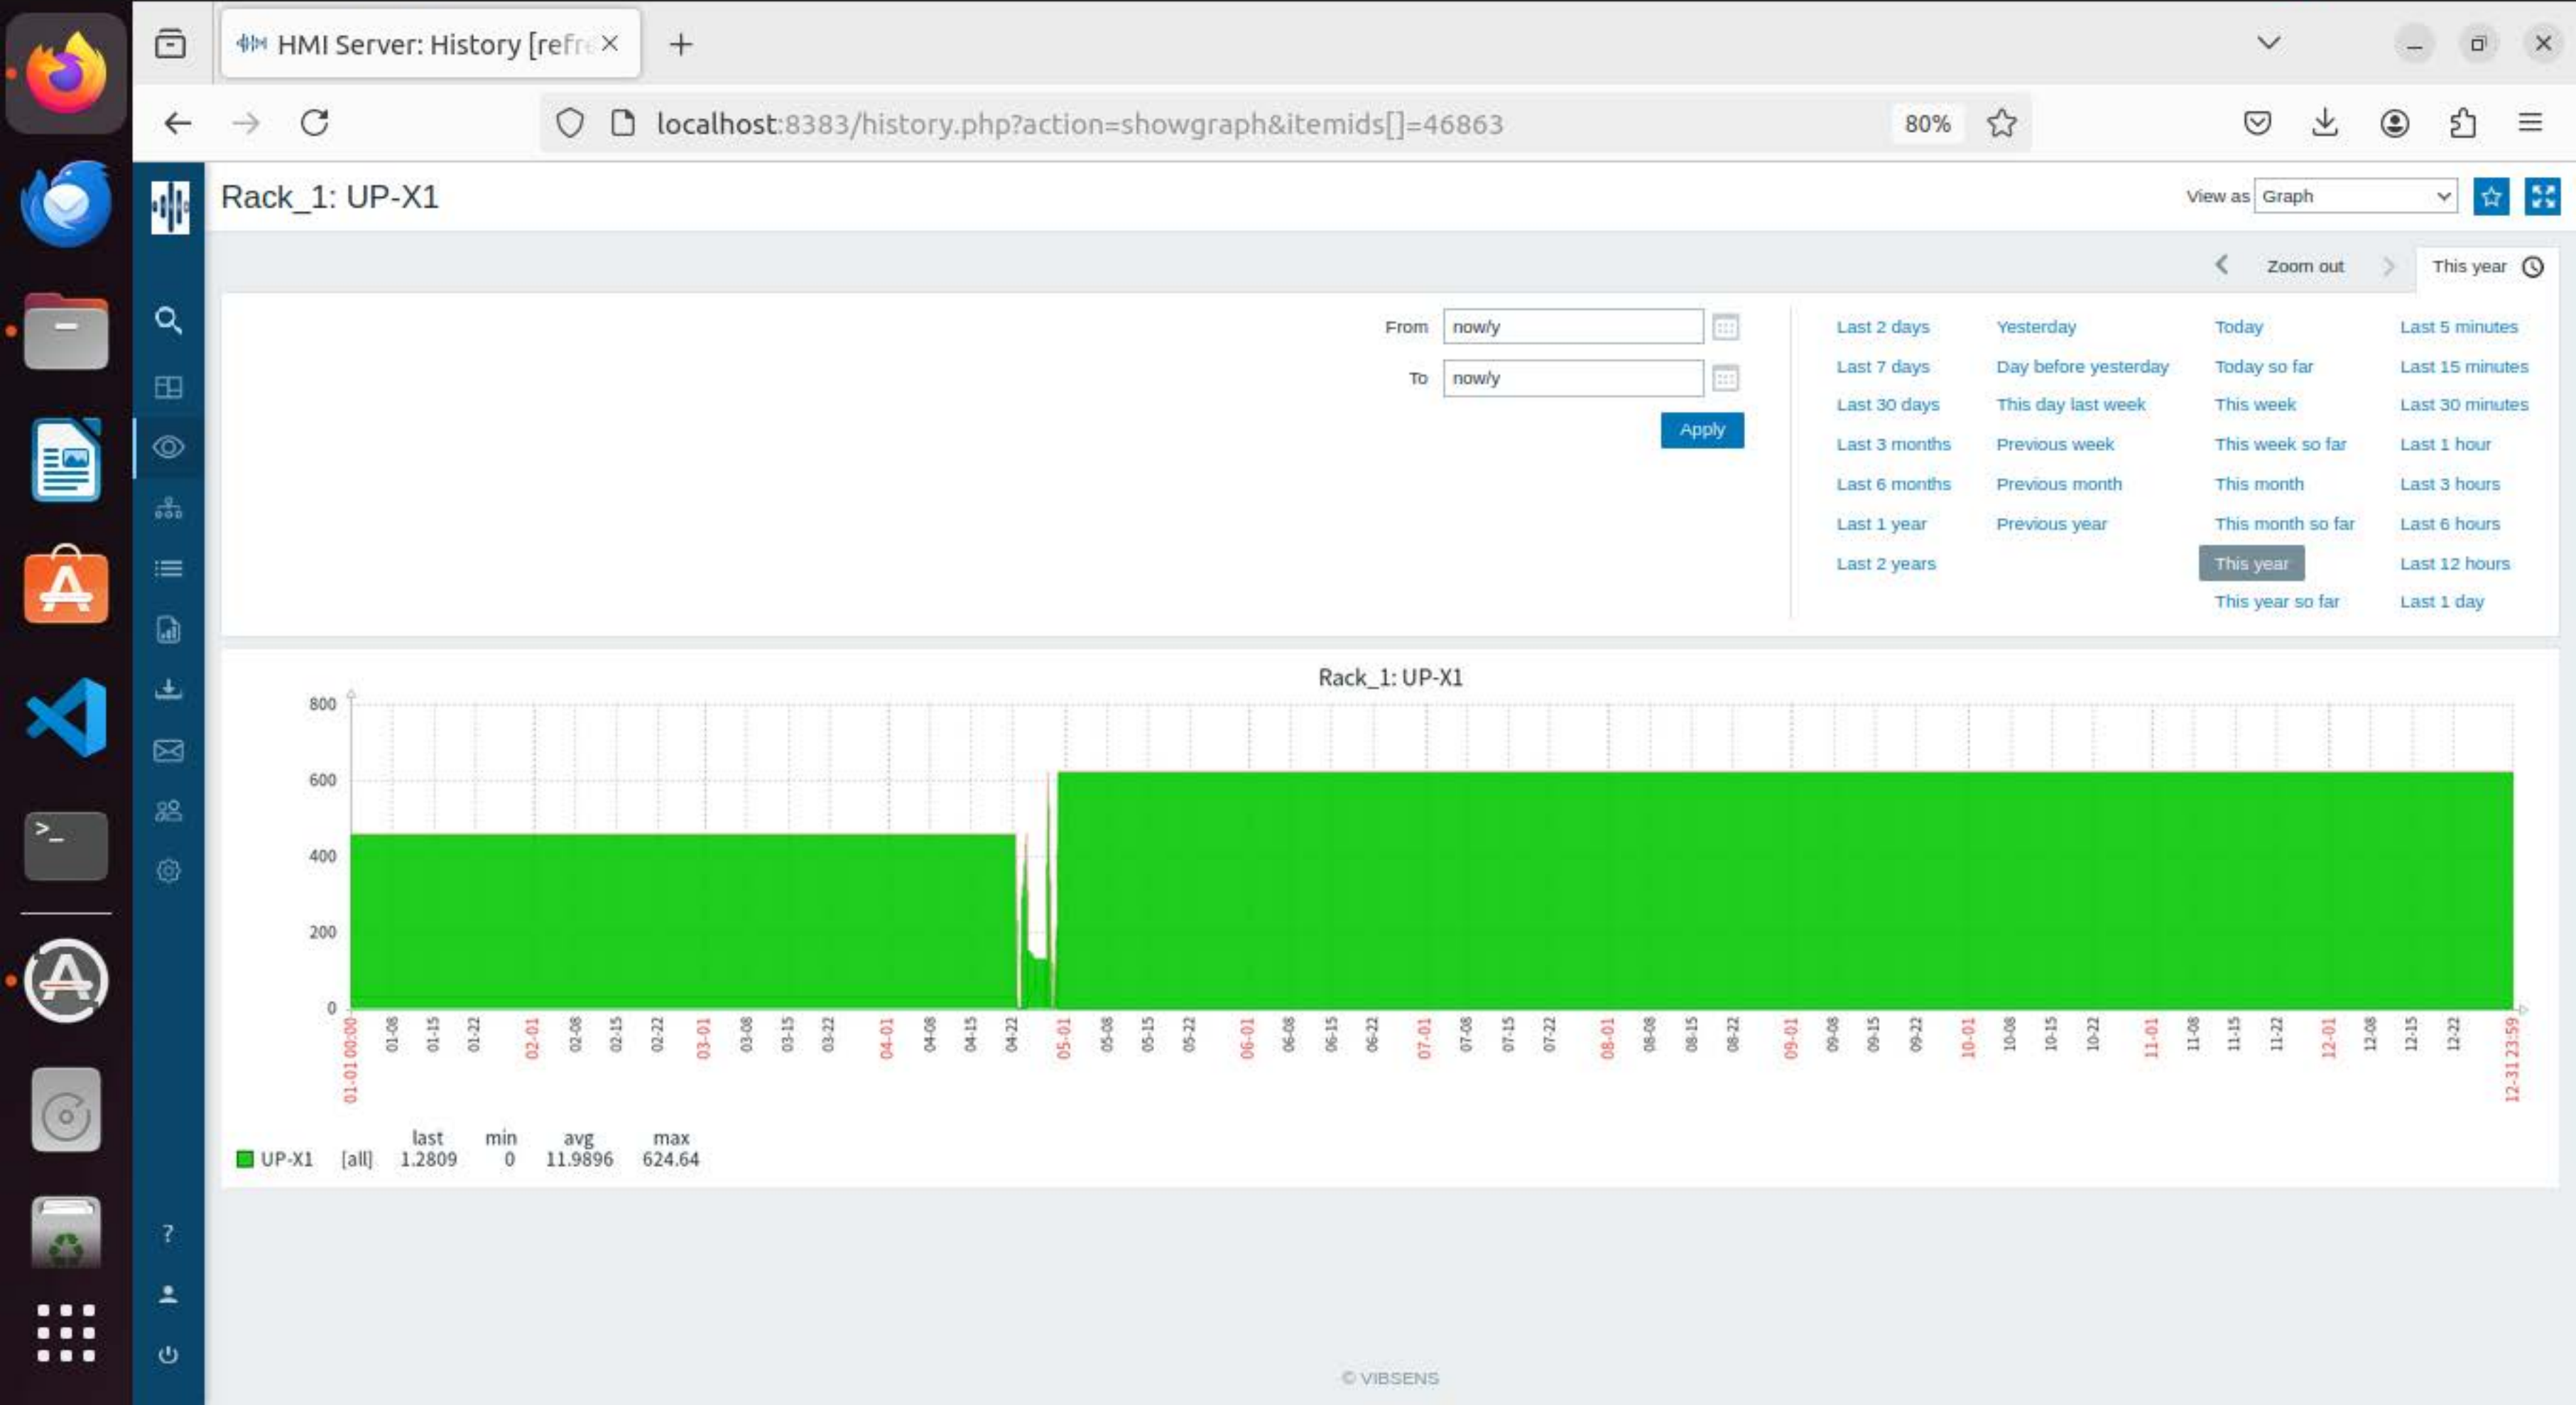

Firefox

Telegram

Files

LibreOffice

App Store

VS Code

Terminal

App Store

System Monitor

Recycle Bin

App Store

📶

🔍

📅

👁

🔗

📄

📁

📧

🔧

?

👤

🔌

HMI Server: Problems

+

🔒

📄

localhost:8383/zabbix.php?show=1&name=&inventory[0][field]=type&inventory[0][value]=8

80%

☆

🔒

📄

👤

📁

☰

Save as

Apply

Reset

☐	Time	Severity	Recovery time	Status	Info	Host	Problem	Duration	Update	Actions	Tags
☐	2024-04-29 17:19:41	Information		PROBLEM		Rack_1	card_1_sensor_1_error	2M 22d 21h	Update		
☐	2024-04-29 17:19:41	Information		PROBLEM		Rack_1	card_1_sensor_2_error	2M 22d 21h	Update		
☐	2024-04-29 17:19:41	Information		PROBLEM		Rack_1	card_1_sensor_3_error	2M 22d 21h	Update		
☐	2024-04-29 17:19:41	Information		PROBLEM		Rack_1	card_1_sensor_4_error	2M 22d 21h	Update		
☐	2024-04-29 17:19:40	Information		PROBLEM		Rack_1	card_5_sensor_1_error	2M 22d 21h	Update		
☐	2024-04-29 17:19:40	Information		PROBLEM		Rack_1	card_5_sensor_2_error	2M 22d 21h	Update		
☐	2024-04-29 17:19:40	Information		PROBLEM		Rack_1	card_4_sensor_1_error	2M 22d 21h	Update		
☐	2024-04-29 17:19:40	Information		PROBLEM		Rack_1	card_4_sensor_2_error	2M 22d 21h	Update		
☐	2024-04-29 17:19:40	Information		PROBLEM		Rack_1	card_4_sensor_3_error	2M 22d 21h	Update		
☐	2024-04-29 17:19:40	Information		PROBLEM		Rack_1	card_4_sensor_4_error	2M 22d 21h	Update		
☐	2024-04-29 17:19:40	Information		PROBLEM		Rack_1	card_3_sensor_1_error	2M 22d 21h	Update		
☐	2024-04-29 17:19:40	Information		PROBLEM		Rack_1	card_3_sensor_2_error	2M 22d 21h	Update		
☐	2024-04-29 17:19:40	Information		PROBLEM		Rack_1	card_3_sensor_3_error	2M 22d 21h	Update		
☐	2024-04-29 17:19:40	Information		PROBLEM		Rack_1	card_3_sensor_4_error	2M 22d 21h	Update		
☐	2024-04-29 17:19:40	Information		PROBLEM		Rack_1	card_2_sensor_1_error	2M 22d 21h	Update		
☐	2024-04-29 17:19:40	Information		PROBLEM		Rack_1	card_2_sensor_2_error	2M 22d 21h	Update		
☐	2024-04-29 17:19:40	Information		PROBLEM		Rack_1	card_2_sensor_3_error	2M 22d 21h	Update		
☐	2024-04-29 17:19:40	Information		PROBLEM		Rack_1	card_2_sensor_4_error	2M 22d 21h	Update		
☐	2024-04-28 13:15:34	Disaster		PROBLEM		Rack_1	card_3_sensor_4_danger	2M 24d 1h	Update		
☐	2024-04-24 17:38:52	Warning		PROBLEM		Rack_1	card_1_sensor_1_alarm	2M 27d 20h	Update		
☐	2024-04-11 19:00:26	Average		PROBLEM		Zabbix server	Linux: Zabbix agent is not available (for 3m)	3M 10d 19h	Update		class: os component: system scope: availability ...

Displaying 21 of 21 found

